

Curing Concrete

Chapter **10**

Introduction


Curing: is the maintenance of a satisfactory moisture content and temperature in concrete for a sufficient period of time during and immediately following placing to promotes continued hydration of cementitious materials so that the desired properties may develop.



Why Curing Is Necessary?

- Concrete dries with time and the relative humidity within it can drop due to loss of water by evaporation and cement hydration where the internal relative humidity in the capillaries decreases causing the paste to self-desiccate.
- When the relative humidity within the concrete drops to about 80% or the temperature of the concrete drops below 10°C , the hydration virtually stops. So curing is needed to maintain internal relative humidity and regulate concrete temperature.
- Tests show that curing has a strong influence on the properties of hardened concrete. Curing improves strength, volume stability, permeability resistance, and durability (including abrasion resistance and resistance to freezing and thawing and deicer scaling).

Why Curing Is Necessary?

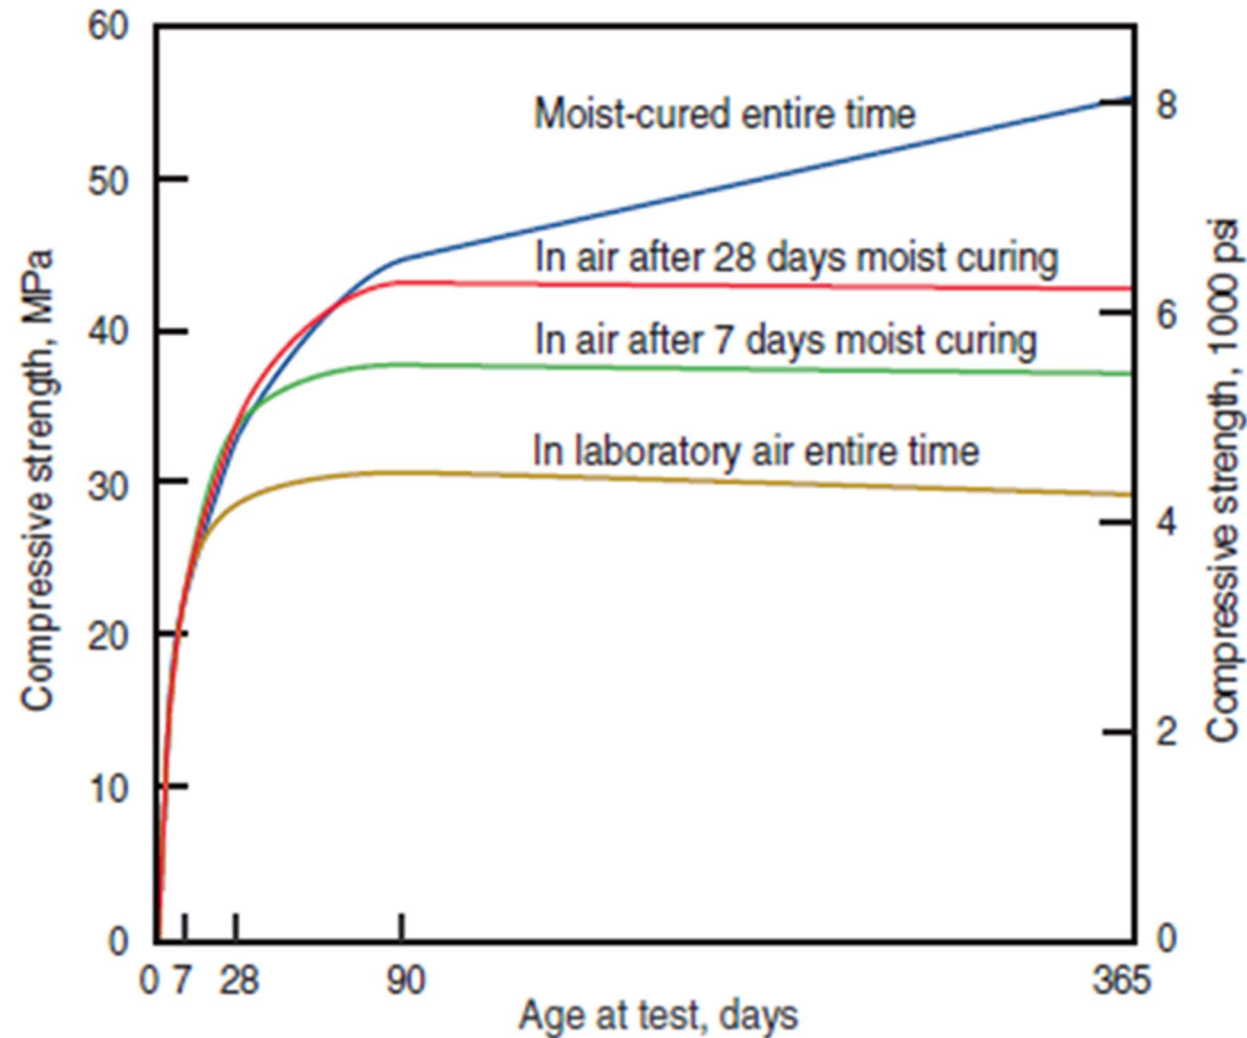


Effect of moist curing time on strength gain of concrete

Important notes

- Loss of water by evaporation. The rate of evaporation depends on the temperature and relative humidity of the surrounding air and on the velocity of wind. Evaporation rates greater than 0.5 kg/m^2 per hour have to be avoided.
- Concrete mixtures with high cement contents and low water-cementing materials ratios (less than 0.40) may require special curing needs.
- When moist curing is interrupted, the development of strength stops. However, if moist curing is resumed, strength development will be reactivated, but the original potential strength may not be achieved.
- Loss of water will also cause the concrete to shrink, thus creating tensile stresses within the concrete which may cause surface cracking.

Estimation of Evaporation Rate

- The rate of potential evaporation due to environment can be estimated from the nomograph shown.
- This estimation is important for the engineer to determine when precautionary measures should be taken during concreting.

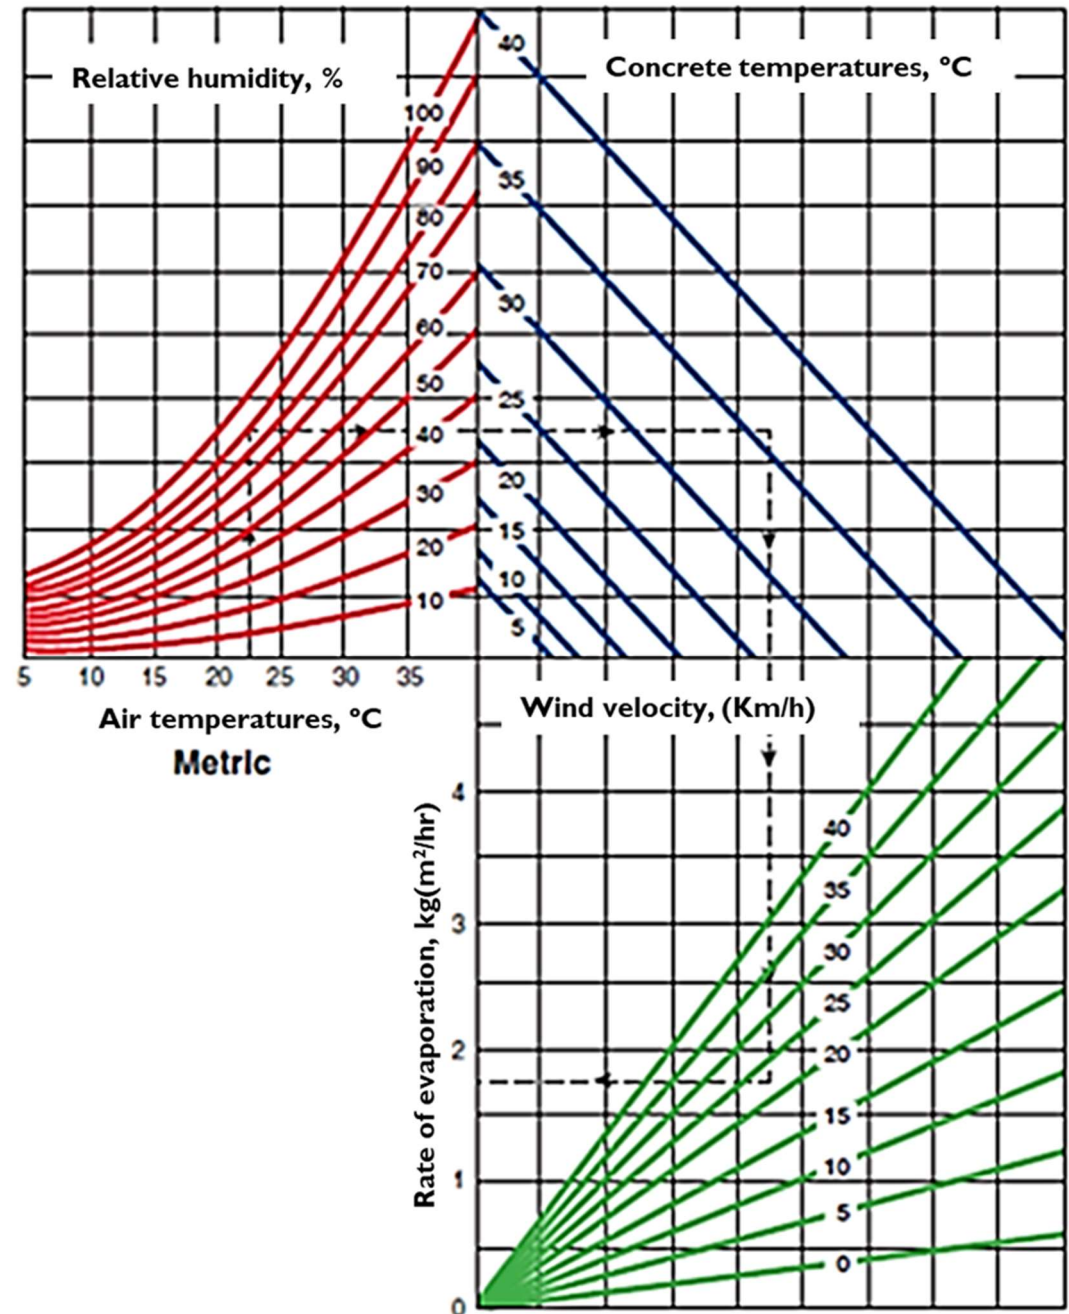


Curing Methods

Curing can be performed by any of the following approaches:

- Maintaining the presence of water in the concrete during early ages. Methods to maintain the water pressure include ponding or immersion, spraying or fogging, and wet coverings.
- Preventing loss of mixing water from the concrete by sealing the surface. Methods to prevent water loss include impervious papers or plastic sheets, membrane-forming compounds, and leaving the forms in place.
- Accelerating the strength gain by supplying heat and additional moisture to the concrete. Accelerated curing methods include steam curing, insulating blankets or covers, and various heating techniques.

Ponding and Immersion

- Ponding is typically used to cure horizontal surfaces, such as pavements and floors.
- Ponding is an ideal method for preventing loss of moisture from the concrete;
- Ponding is also effective for maintaining a uniform temperature in the concrete.
- Immersion: total immersion of the finished concrete element in water. This method is commonly used in the laboratory for curing concrete test specimens.

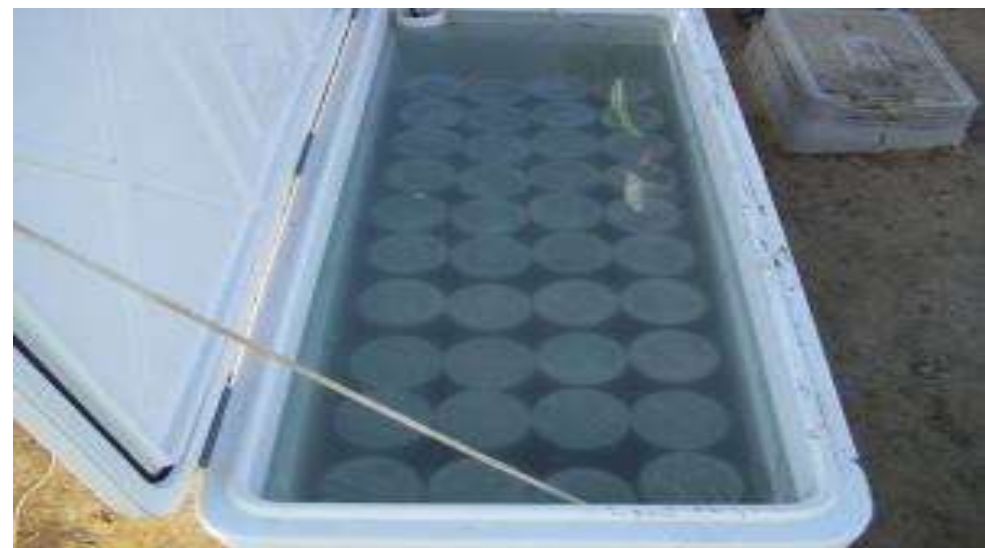

Spraying or fogging

- A system of nozzles or sprayers can be used to provide continuous spraying or fogging.
- This method requires a large amount of water and could be expensive.
- It is most suitable in high temperature and low humidity environments.




Wet Covering

- Moisture-retaining fabric coverings saturated with water, such as burlap, cotton mats, and rugs are used in many applications.
- The fabric can be kept wet, either by periodic watering or covering the fabric with polyethylene film to retain moisture.
- On small jobs, wet coverings of earth, sand, saw dust, hay, or straw can be used.
- Stains or discoloring of concrete could occur with some types of wet coverings.



Impervious Papers or Plastic Sheets

- Used to obtain a continuous seal over the concrete surface by means of a firm impervious film to prevent moisture in concrete from escaping by evaporation. To achieve best results, membrane is applied after one or two days' of actual wet curing.
- The membrane can be made white to reflect sunlight and reduce absorption of heat in summer or can be colored black to increase absorption of heat in winter.

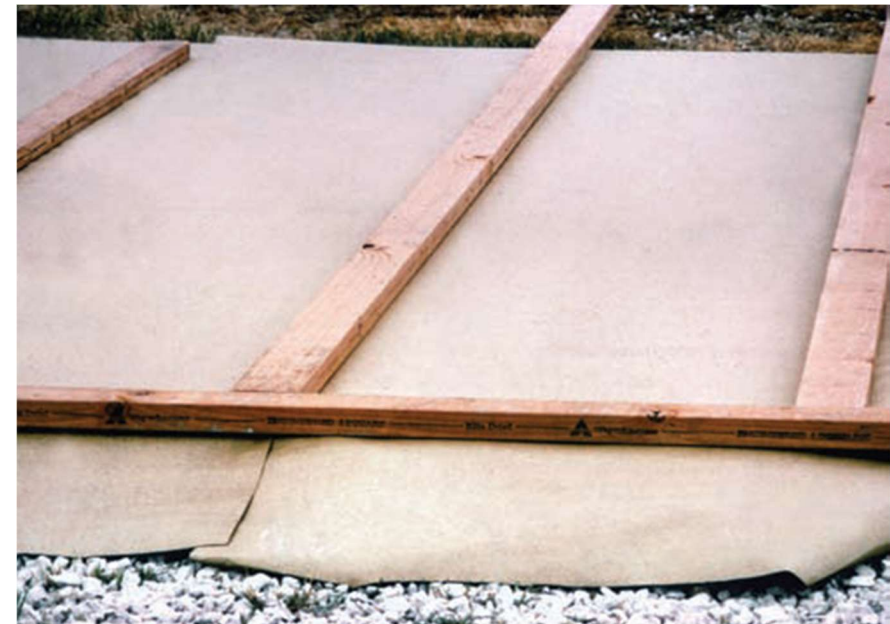

Curing Compounds

- Various types of liquid membrane-forming compounds can be applied to the concrete surface to reduce or retard moisture loss.
- These can be used to cure fresh concrete, as well as hardened concrete, after removal of forms or after moist curing.
- These compounds provide the least effective method of curing, since they do not entirely prevent evaporation from the concrete.



Forms left in place

- Loss of moisture can be reduced by leaving the forms in place as long as practical, provided that the top concrete exposed surface is kept wet.
- If wood forms are used, the forms should also be kept wet. After removing the forms, another curing method can be used.

Accelerated Curing - Steam Curing

- Steam curing is advantageous where early strength gain in concrete is important or where additional heat is required to accomplish hydration, as in cold weather.
- Steam curing is used primarily for precast concrete products such as masonry block, pipe, prestressed beams, and wall panels.
- Maximum curing temperatures may be anywhere in the range 40 to 100°C, although the optimum temperature is in the range 65 to 80°C.
- The concrete products attain the 28 days strength of normal concrete in about 3 days.

Curing Period

- The curing period should be as long as is practical.
- The minimum time depends on several factors, such as type of cement, mixture proportions, required strength, ambient weather, size and shape of the structure, future exposure conditions, and method of curing.
- For most concrete structures the curing period at temperatures above 5°C should be a minimum of seven days or until 70% of specified compressive or flexure strength is attained.
- The curing period can be reduced to three days if high early strength concrete is used and the temperature is above 10°C .


Concrete mix design

Chapter 13

Mix design or Proportioning


Mix design or Proportioning is the process of selecting suitable ingredients of concrete and determining their relative quantities for producing a unit amount of concrete satisfying the following requirements:

- Strength of hardened concrete
- Workability of fresh concrete
- Economy
- Durability

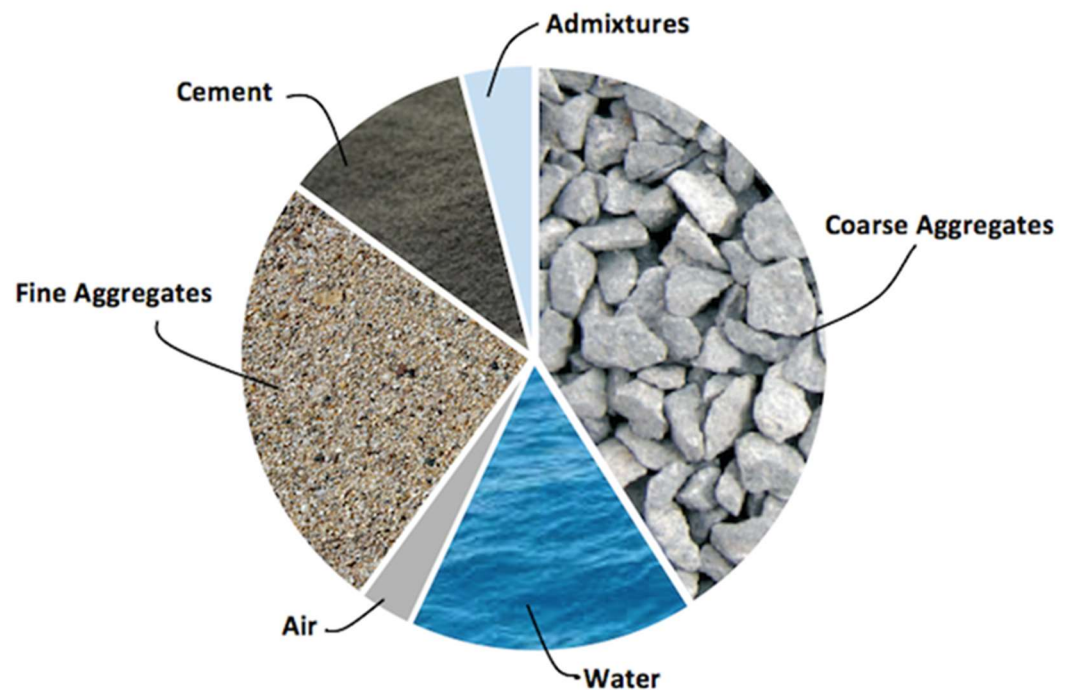




Determination of design requirements

- Strength of hardened concrete is specified by the designer of the structure.
- Workability and other properties of fresh concrete are governed by the type of construction and by the techniques of placing and transporting, taking into consideration the degree of control exercised on site.

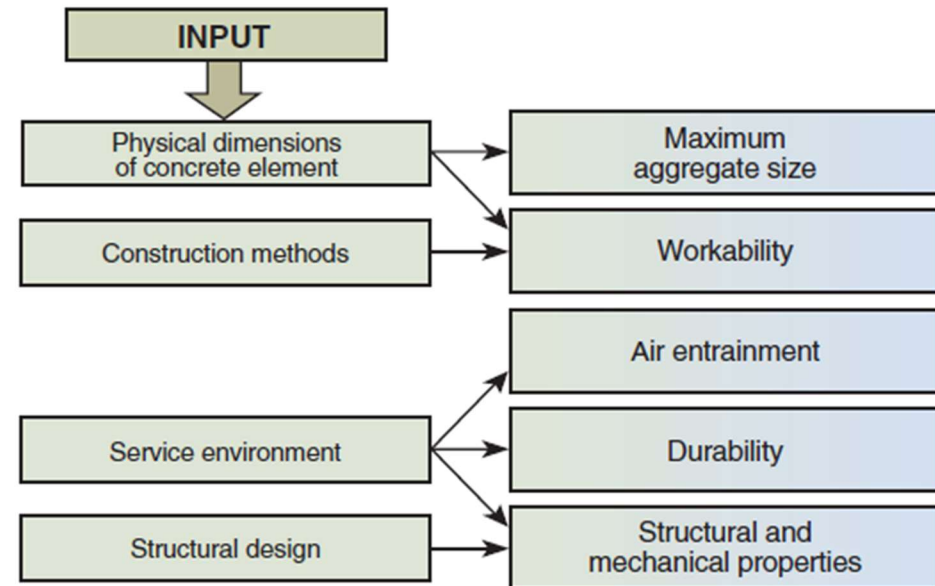

- Durability is usually determined by the applicable specifications that lay down limiting values for a range of properties that must be satisfied. These properties are usually: the maximum water/cement ratio, minimum cement content, minimum strength, and air content for specific application or environment.

Concrete Mix Design Relationships

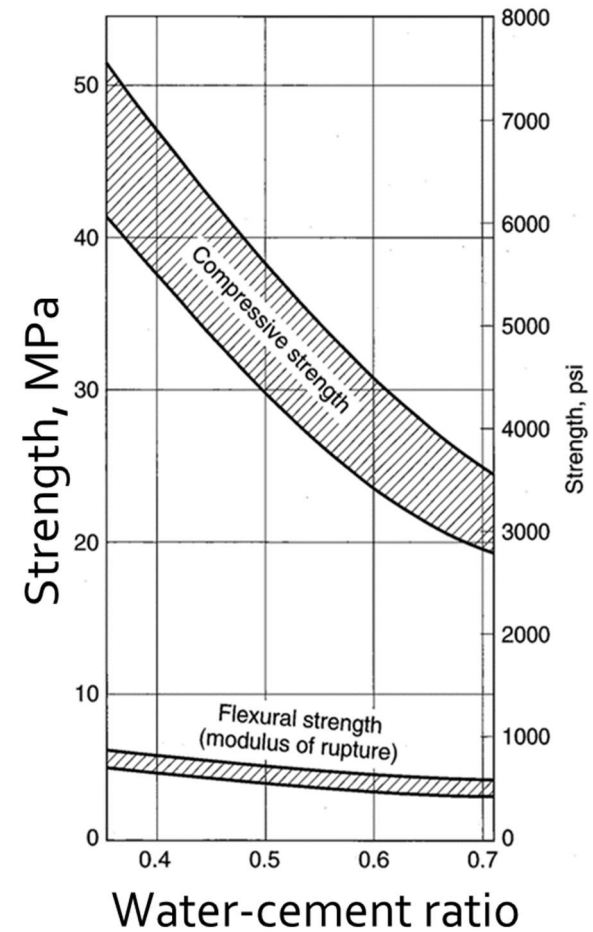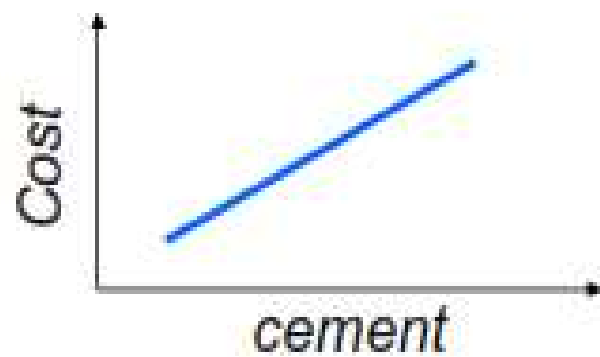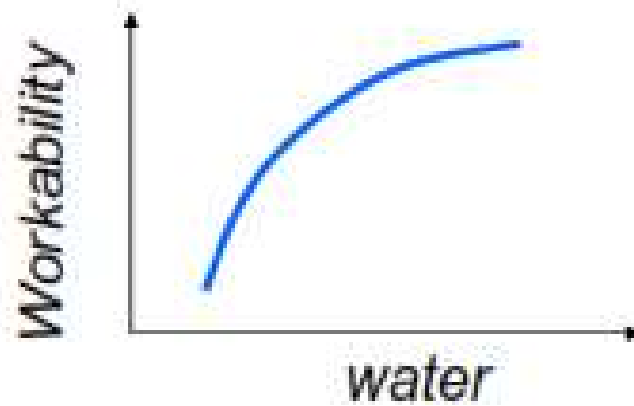

Mix design procedures

- It should be explained that design of the mix in the strict sense of the word is not possible: the materials used are variable in a number of respects and many of their properties cannot be assessed truly quantitatively, so that we are really making no more than an intelligent guess at the optimum combinations of the ingredients on the basis of the relationships established in the earlier chapters. It is not surprising, therefore, that in order to obtain a satisfactory mix we must check the estimated proportions of the mix by making trial mixes and, if necessary, make appropriate adjustments to the proportions until a satisfactory mix has been obtained.
- Several mix design methods have been developed over the years, ranging from an arbitrary volume method (1:2:3 cement: sand: coarse aggregate) to the more accurate methods such as the American (ACI 211.1-91) method of mix design and the British method for normal weight concrete, developed for the Department of the Environment in 1975 and revised in 1988.

American method of mix design (ACI 211.1-91)

The basic steps required for determining mix design proportions are as follows

1. Evaluate strength requirements.
2. Determine the water-cement (water–cementitious materials) ratio required.
3. Evaluate coarse aggregate requirements.
 - maximum aggregate size of the coarse aggregate
 - quantity of the coarse aggregate
4. Determine air entrainment requirements.
5. Evaluate workability requirements of the plastic concrete.
6. Estimate the water content requirements of the mix.
7. Determine cementing materials content and type needed.
8. Determine coarse and fine aggregate content.
9. Determine moisture corrections.
10. Make and test trial mixes.

American method of mix design - Required information

Before starting the mix design process, information is required on both the materials to be used and the structure into which the concrete will be placed. These include

- Raw material properties including sieve analyses of both the fine and coarse aggregates, unit weight of the coarse aggregate, bulk specific gravities, and absorption capacities of the aggregates. In addition to the type and characteristics of the available cement.
- Information on the structure including the type and dimensions of the structural members, the minimum space between reinforcing bars, the required concrete strength, and the exposure conditions to which the concrete will be subjected.

Determination of the Target Strength

- The materials engineer designs the concrete to have an average strength greater than the strength specified by the structural engineer (f'_c).
- The specified compressive strength f'_c shall be \geq the minimum design compressive strength specified in the specifications or the durability requirements (table 3).
- The target strength required in the mix design (the average strength, f'_{cr}) shall be determined from the specified compressive strength (f'_c) based on statistical data if available or the table (1) can be used.

Table 1

Specified compressive strength, f'_c , MPa	Required average compressive strength, f'_{cr} , MPa
Less than 21	$f'_c + 7.0$
21 to 35	$f'_c + 8.5$
Over 35	$1.10 f'_c + 5.0$

Statistically :

$$f'_{cr} = f'_c + 1.34S$$
$$\text{or } f'_{cr} = f'_c + 2.33S - 3.54$$

where

f'_{cr} = required average compressive strength, MPa

f'_c = specified compressive strength, MPa

s = standard deviation, MPa

Determination of the mix Workability (slump)

- **Slump** is usually indicated in the job specifications (designer requirements) as a range, such as 50 to 100 mm, or as a maximum value not to be exceeded.
- When slump is not specified, an approximate value can be selected from Table (2) for concrete consolidated by mechanical vibration.

Table 2 Recommended Slumps for Various Types of Construction

Concrete construction	Slump, mm (in.)	
	Maximum*	Minimum
Reinforced foundation walls and footings	75 (3)	25 (1)
Plain footings, caissons, and substructure walls	75 (3)	25 (1)
Beams and reinforced walls	100 (4)	25 (1)
Building columns	100 (4)	25 (1)
Pavements and slabs	75 (3)	25 (1)
Mass concrete	75 (3)	25 (1)

*May be increased 25 mm (1 in.) for consolidation by hand methods, such as rodding and spading.


Plasticizers can safely provide higher slumps.

Adapted from ACI 211.1.

Determination of maximum size of Coarse aggregate

- Concretes with the larger-sized aggregates require less mortar per unit volume of concrete. Thus the ACI method is based on the principle that the maximum size of aggregate should be the largest available so long it is consistent with the dimensions of the structure.
- The maximum aggregate size can be specified in the job specification or the material engineer shall calculate it based on the information that has been collected about the structure for which the mix will be designed as shown below.

- One-fifth the narrowest dimension of a vertical concrete member: $D_{\max} = 1/5 B$
- Three-quarters the clear spacing between reinforcing bars and between the reinforcing bars and forms: $D_{\max} = 3/4 S$, and $3/4 C$
- One-third the depth of slabs: $D_{\max} = 1/3 T$

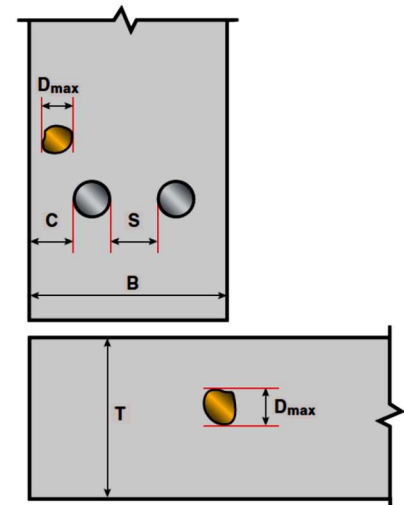

Durability requirements

- It is important that the water/cement ratio selected on the basis of strength and the minimum compressive design strength is satisfactory also for the durability requirements. The tables on the next slide show w/c requirements for various exposure conditions.
- **Air - entrained concrete.** It must be remembered that air – entrained concrete must be considered under conditions of freezing and thawing or exposure to de-icing salts

Durability requirements

Table 3 Maximum Water-Cementitious Material Ratios and Minimum Design Strengths for Various Exposure Conditions

Exposure category	Exposure condition	Maximum water-cementitious material ratio by mass for concrete	Minimum design compressive strength f'_c , MPa (psi)
F0, S0, W0, C0	Concrete protected from exposure to freezing and thawing, application of deicing chemicals, or aggressive substances	Select water-cementitious ratio on basis of strength, workability, and finishing needs	Select strength based on structural requirements
W1, S1	Concrete intended to have low permeability when exposed to water (W1) or moderate sulfates (S1)	0.50	28 (4000)
F1	Concrete exposed to freezing and thawing with limited exposure to moisture	0.55	25 (3500)
F2, S2	Concrete exposed to freezing and thawing with exposure to moisture (F2) or severe sulfates (S2) ¹	0.45	31 (4500)
F3*, S3	Concrete exposed to freezing-and-thawing cycles with frequent exposure to water and exposure to deicing chemicals (F3) or very severe sulfates (S3)	0.40	35 (5000)
C2	For corrosion protection for reinforced concrete exposed to chlorides from deicing salts, salt water, brackish water, seawater, or spray from these sources	0.40	35 (5000)

Adapted from ACI 318-14. The following four exposure categories determine durability requirements for concrete: (1) F – Freezing and Thawing; (2) S – Sulfates; (3) W – Water; and (4) C – Corrosion. Increasing numerical values represent increasingly severe exposure conditions.

* For plain concrete, the maximum w/cm shall be 0.45 and the minimum design strength shall be 31 MPa (4500 psi).

Required water/cement ratio

- The water/cement ratio required to produce a given mean compressive strength is best determined from previously established relations for mixes made from similar ingredients or by carrying out tests using trial mixes made with the actual ingredients to be used in the construction, including admixtures. However, Table (4) may be used to estimate the approximate water/cement ratio.
- It is important that the water/cement ratio selected on the basis of strength is satisfactory also for the durability requirements.
- Interpolation can be used to obtain w/c value for intermediate strength.

Table 4 Relationship Between Water to Cementitious Material Ratio and Compressive Strength of Concrete

Compressive strength at 28 days, MPa	Water-cementitious materials ratio by mass	
	Non-air-entrained concrete	Air-entrained concrete
45	0.38	0.30
40	0.42	0.34
35	0.47	0.39
30	0.54	0.45
25	0.61	0.52
20	0.69	0.60
15	0.79	0.70

Strength is based on cylinders moist-cured 28 days in accordance with ASTM C31 (AASHTO T 23). Relationship assumes nominal maximum size aggregate of about 19 to 25 mm. Adapted from ACI 211.1 and ACI 211.3.

Water Content

- Based on the chosen workability, and nominal aggregate size we can estimate the water content of the mix (mass of water per unit volume of concrete) from table (5).
- As shown in Table 5, ACI 211.1-91 gives the water content for various maximum sizes of aggregate and workability's, with and without air entrainment. The values apply for well-shaped angular coarse aggregates.

Water Content

Table 5 Recommended water content for various maximum sizes of aggregate and workability's

Slump, mm	Water, kilograms per cubic meter of concrete, for indicated sizes of aggregate*							
	9.5 mm	12.5 mm	19 mm	25 mm	37.5 mm	50 mm**	75 mm**	150 mm**
Non-air-entrained concrete								
25 to 50	207	199	190	179	166	154	130	113
75 to 100	228	216	205	193	181	169	145	124
150 to 175	243	228	216	202	190	178	160	—
Approximate amount of entrapped air in non-air-entrained concrete, percent	3	2.5	2	1.5	1	0.5	0.3	0.2
Air-entrained concrete								
25 to 50	181	175	168	160	150	142	122	107
75 to 100	202	193	184	175	165	157	133	119
150 to 175	216	205	197	184	174	166	154	—
Recommended average total air concrete, percent, for level of exposure:†								
Mild exposure	4.5	4.0	3.5	3.0	2.5	2.0	1.5	1.0
Moderate exposure (Class F1)	6.0	5.5	5.0	4.5	4.5	4.0	3.5	3.0
Severe exposure (Class F2 and F3)	7.5	7.0	6.0	6.0	5.5	5.0	4.5	4.0

* These quantities of mixing water are for use in computing cementitious material contents for trial batches. They are maximums for reasonably well-shaped angular coarse aggregates graded within limits of accepted specifications.

** The slump values for concrete containing aggregates larger than 37.5 mm are based on slump tests made after removal of particles larger than 37.5 mm by wet screening.

† The air content in job specifications should be specified to be delivered within -1 to +2 percentage points of the table target value for moderate and severe exposures.

Adapted from ACI 211.1 and ACI 318. Hover (1995) presents this information in graphical form.

Cement content

- The cement content is governed by the mixing water requirement and the water/cement ratio as shown below.

$$\{\textit{weight of cement}\} = \frac{\textit{weight of water}}{w/c}$$

- The calculated cement content has to be at least equal to that laid down by specifications or durability considerations.

Aggregate Content – Coarse aggregates

- The dry bulk volume of coarse aggregate per unit volume of concrete is taken to depend on the fineness modulus of the fine aggregate and on the maximum size of aggregate as shown by table (6).
- The oven dry (OD) weight of coarse aggregate required per cubic meter of concrete is simply equal to the value from Table (6) multiplied by the dry-rodded unit weight of the aggregate in kg/m³.
- To convert from OD to SSD weights, multiply by $(1 + A_b/100)$ where A_b is the absorption.

Table 6 Bulk Volume of Coarse Aggregate Per Unit Volume of Concrete

Nominal maximum size of aggregate, mm (in.)	Bulk volume of dry-rodded coarse aggregate per unit volume of concrete for different fineness moduli of fine aggregate*			
	2.40	2.60	2.80	3.00
9.5 (3/8)	0.50	0.48	0.46	0.44
12.5 (1/2)	0.59	0.57	0.55	0.53
19 (3/4)	0.66	0.64	0.62	0.60
25 (1)	0.71	0.69	0.67	0.65
37.5 (1 1/2)	0.75	0.73	0.71	0.69
50 (2)	0.78	0.76	0.74	0.72
75 (3)	0.82	0.80	0.78	0.76
150 (6)	0.87	0.85	0.83	0.81

*Bulk volumes are based on aggregates in a dry-rodded condition as described in ASTM C29 (AASHTO T 19). Adapted from ACI 211.1.

Aggregate content – Fine aggregates

- The fine aggregate content per unit volume of concrete is then estimated using either the mass method or the volume method. The volume method is more accurate procedure for calculating the required amount of fine aggregate and will be applied here.
- The mass of fine aggregate using the volume method , A_f , is given by the following equation:

$$A_f = \gamma_f \left[1000 - \left(W + \frac{C}{\gamma} + \frac{A_c}{\gamma_c} + 10A \right) \right]$$

where

A_c = coarse aggregate content, kg/m³

C = cement content, kg/m³

W = mixing water requirement, kg/m³

A = air content, per cent;

γ = specific gravity of cement (generally 3.15)

γ_c = bulk specific gravity (SSD) of coarse aggregate

γ_f = bulk specific gravity (SSD) of fine aggregate

Adjustments for Aggregate Moisture

- **Aggregate weights.** Aggregate volumes are calculated based on oven dry unit weights, but aggregate is typically batched based on actual weight. Therefore, any moisture in the aggregate will increase its weight. Stockpiled aggregates almost always contain some moisture. Without correcting for this, the batched aggregate volumes will be incorrect.
- **Amount of mixing water.** If the batched aggregate is anything but saturated surface dry it will absorb water (if oven dry or air dry) or give up water (if wet) to the cement paste. This causes a net change in the amount of water available in the mix and must be compensated for by adjusting the amount of mixing water added.

Trial Batch Adjustments.

- Having now estimated the proportions of all the ingredients, the next step is to prepare a trial batch using these estimates.
- The fresh concrete should be tested for slump, unit weight, air content, and its tendencies to segregate, bleed, and finishing characteristics. Also, hardened samples should be tested for compressive and flexural strength.
- Modification shall be carried out based on the trial mix results.

Example

Concrete is required for an exterior column to be located above ground level in an area where it will be mostly dry but subjected to mild freezing and thawing. The concrete is required to have an average 28-day compressive strength **of 20 Mpa**. For the conditions of placement, the slump should be between 75 and 100 mm. The column is 650 mm square with a minimum clear space for aggregate of 50 mm The properties of the materials are as follows:

- **Cement:** Type I, specific gravity = 3.15
- **Fine aggregate:** Bulk specific gravity (SSD) = 2.63; absorption capacity = 1.3 % ;
surface moisture = 4.2 % based on SSD state; fineness modulus = 2.70
- **Coarse aggregate:** Maximum size = 19 mm; bulk specific gravity (SSD) = 2.68;
absorption capacity = 1.0%; surface moisture = 0.5% based on SSD state; dry-rodded unit weight = 1600 kg/m³.
- The sieve analyses of the coarse and fine aggregates fall within the limits specified in ASTM C 33. Design the required mix.

Review of given data

- **Choice of slump.** The required slump (75 and 100) is consistent with the typical values given in Table 1 for building columns (25 -100 mm) → OK
- **Maximum aggregate size.** The available maximum aggregate size, 19 mm, meets the limitations of one-fifth of the minimum dimension between forms ($650/5=130$) and three-fourths of the minimum clear space. ($3/4 * 50=37.5$) → OK

Concrete construction	Slump, mm (in.)	
	Maximum*	Minimum
Reinforced foundation walls and footings	75 (3)	25 (1)
Plain footings, caissons, and substructure walls	75 (3)	25 (1)
Beams and reinforced walls	100 (4)	25 (1)
Building columns	100 (4)	25 (1)
Pavements and slabs	75 (3)	25 (1)
Mass concrete	75 (3)	25 (1)

Durability requirements - Exposure condition

- Since the concrete will be subjected to limited moisture in mild freezing – thawing zone (F1), ordinary Portland (Type I) cement can be used, but concrete must be air entrained.
- According to table 3, and for exposure category F1, the maximum allowable w/c is 0.55 and minimum design strength of 25 Mpa > 20 Mpa required $\rightarrow f'_c = 25 \text{ Mpa}$.

Exposure category	Exposure condition	Maximum water-cementitious material ratio by mass for concrete	Minimum design compressive strength f'_c , MPa (psi)
F0, S0, W0, C0	Concrete protected from exposure to freezing and thawing, application of deicing chemicals, or aggressive substances	Select water-cementitious ratio on basis of strength, workability, and finishing needs	Select strength based on structural requirements
W1, S1	Concrete intended to have low permeability when exposed to water (W1) or moderate sulfates (S1)	0.50	28 (4000)
F1	Concrete exposed to freezing and thawing with limited exposure to moisture	0.55	25 (3500)
F2, S2	Concrete exposed to freezing and thawing with exposure to moisture (F2) or severe sulfates (S3)	0.45	31 (4500)
F3*, S3	Concrete exposed to freezing-and-thawing cycles with frequent exposure to water and exposure to deicing chemicals (F3) or very severe sulfates (S3)	0.40	35 (5000)
C2	For corrosion protection for reinforced concrete exposed to chlorides from deicing salts, salt water, brackish water, seawater, or spray from these sources	0.40	35 (5000)

f'_{cr} and required W/C ratio

- Using table 1, the required average strength $f'_{cr} = f'_c + 8.5 = 25 + 8.5 = 33.5$ Mpa.
- From Table 4, for air-entrained concrete, by interpolation, the required W/C ratio for a required strength of 33.5 Mpa is **0.4** (< .55 required by the durability requirement).

Compressive strength at 28 days, MPa	Water-cementitious materials ratio by mass	
	Non-air-entrained concrete	Air-entrained concrete
45	0.38	0.30
40	0.42	0.34
<u>33.5</u>	0.47	0.39
30	0.54	0.45
25	0.61	0.52
20	0.69	0.60
15	0.79	0.70

Water and air contents

- Entering the lower part of table 5 with a maximum aggregate size of 19 mm and a slump of 75-100 mm,
 - Required water (W) = 184 Kg
 - Air Content (A) = 3.5% for mild exposure
 - → The required cement content (C) = $184/0.4 = 460 \text{ kg/m}^3$

Slump, mm	Water, kilograms per cubic meter of concrete, for indicated sizes of aggregate*							
	9.5 mm	12.5 mm	19 mm	25 mm	37.5 mm	50 mm**	75 mm**	150 mm**
	Non-air-entrained concrete							
25 to 50	207	199	190	179	166	154	130	113
75 to 100	228	216	205	193	181	169	145	124
150 to 175	243	228	216	202	190	178	160	—
Approximate amount of entrapped air in non-air-entrained concrete, percent	3	2.5	2	1.5	1	0.5	0.3	0.2
	Air-entrained concrete							
25 to 50	181	175	168	160	150	142	122	107
75 to 100	202	193	184	175	165	157	133	119
150 to 175	216	205	197	184	174	166	154	—
Recommended average total air concrete, percent, for level of exposure:†								
Mild exposure	4.5	4.0	3.5	3.0	2.5	2.0	1.5	1.0
Moderate exposure (Class F1)	6.0	5.5	5.0	4.5	4.5	4.0	3.5	3.0
Severe exposure (Class F2 and F3)	7.5	7.0	6.0	6.0	5.5	5.0	4.5	4.0

Estimation of coarse aggregate content

- Entering table 6 with max. CA size of 19 mm and an FM of FA = 2.7, by Interpolation the volume of dry-rodded coarse aggregate per unit volume of concrete = $0.63 \text{ m}^3/\text{m}^3$

- The OD weight of the coarse aggregate = $0.63 \times 1600 = 1008 \text{ kg}$
- Given that absorption = 1% \rightarrow The CA (SSD) weight = $(1 + A_b/100)$
 $= 1008 \times 1.01 = \underline{\underline{1018 \text{ kg}}}$

2.70

Nominal maximum size of aggregate, mm (in.)	Bulk volume of dry-rodded coarse aggregate per unit volume of concrete for different fineness moduli of fine aggregate*			
	2.40	2.60	2.80	3.00
9.5 (3/8)	0.50	0.48	0.46	0.44
12.5 (1/2)	0.59	0.57	0.55	0.53
19 (3/4)	0.66	0.64	0.62	0.60
25 (1)	0.71	0.69	0.67	0.65
37.5 (1 1/2)	0.75	0.73	0.71	0.69
50 (2)	0.78	0.76	0.74	0.72
75 (3)	0.82	0.80	0.78	0.76
150 (6)	0.87	0.85	0.83	0.81

0.63

fine aggregate content and aggregate adjustment

$$A_f = \gamma_f \left[1000 - \left(W + \frac{C}{\gamma} + \frac{A_c}{\gamma_c} + 10A \right) \right]$$

- Given that : $W = 184$ Kg; $C = 460$ Kg (SG = 3.15); $A_c = 1018$ Kg (SG = 2.68) ; $A = 3.5\%$

$$A_f = 2.63 \left[1000 - \left(184 + \frac{460}{3.15} + \frac{1018}{2.68} + 10(3.5) \right) \right] = 671 \text{ Kg}$$

- Adjustment for moisture in the aggregate: for the given moisture contents the adjusted aggregate weights are
 - Coarse aggregate (wet) (SM .5%) = $1018 (1.005) = 1023 \text{ kg/m}^3$
 - Fine aggregate (wet)(SM 4.2%) = $671(1.042) = 699 \text{ kg/m}^3$
 - The mixing water adjustment $184 - 1018(0.005) - 671(0.042) = 151 \text{ kg/m}^3$

Batch weights

The estimated batch weights per m³

Water	151 Kg
Cement	460 Kg
Coarse Aggregates	1023 Kg
Fine Aggregates	699 Kg
Total	2333 Kg